N

FIRE ALARM LEGEND

SYMBOL	DESCRIPTION	MODEL No.	
S	SMOKE DETECTOR	4098-9714	
H1	HEAT DETECTOR	4098-9733	
H	WEATHER PROOF HEAT DETECTOR	2098-9490	
F	SPEAKER/STROBE COMBO - 15 CD TAP 3 UNLESS NOTED OTHERWISE	4903-9326	
	STROBE - 15 CANDELLA	4904-9331	
F	MANUAL PULL STATION	2099-9795	
TC	TERMINAL CABINET-F.B.O.	---	
FT	FIRE FIGHTER TELEPHONE	2084-9001	
IAM	INDIVIDUAL ADDRESSABLE MODULE	2190-9172	
WF	WATER FLOW SWITCH-F.B.O.	---	
TS	TAMPER SWITCH-F.B.O.	---	
F.B.O.	FURNISHED BY OTHERS	---	
	END OF LINE RESISTOR	---	

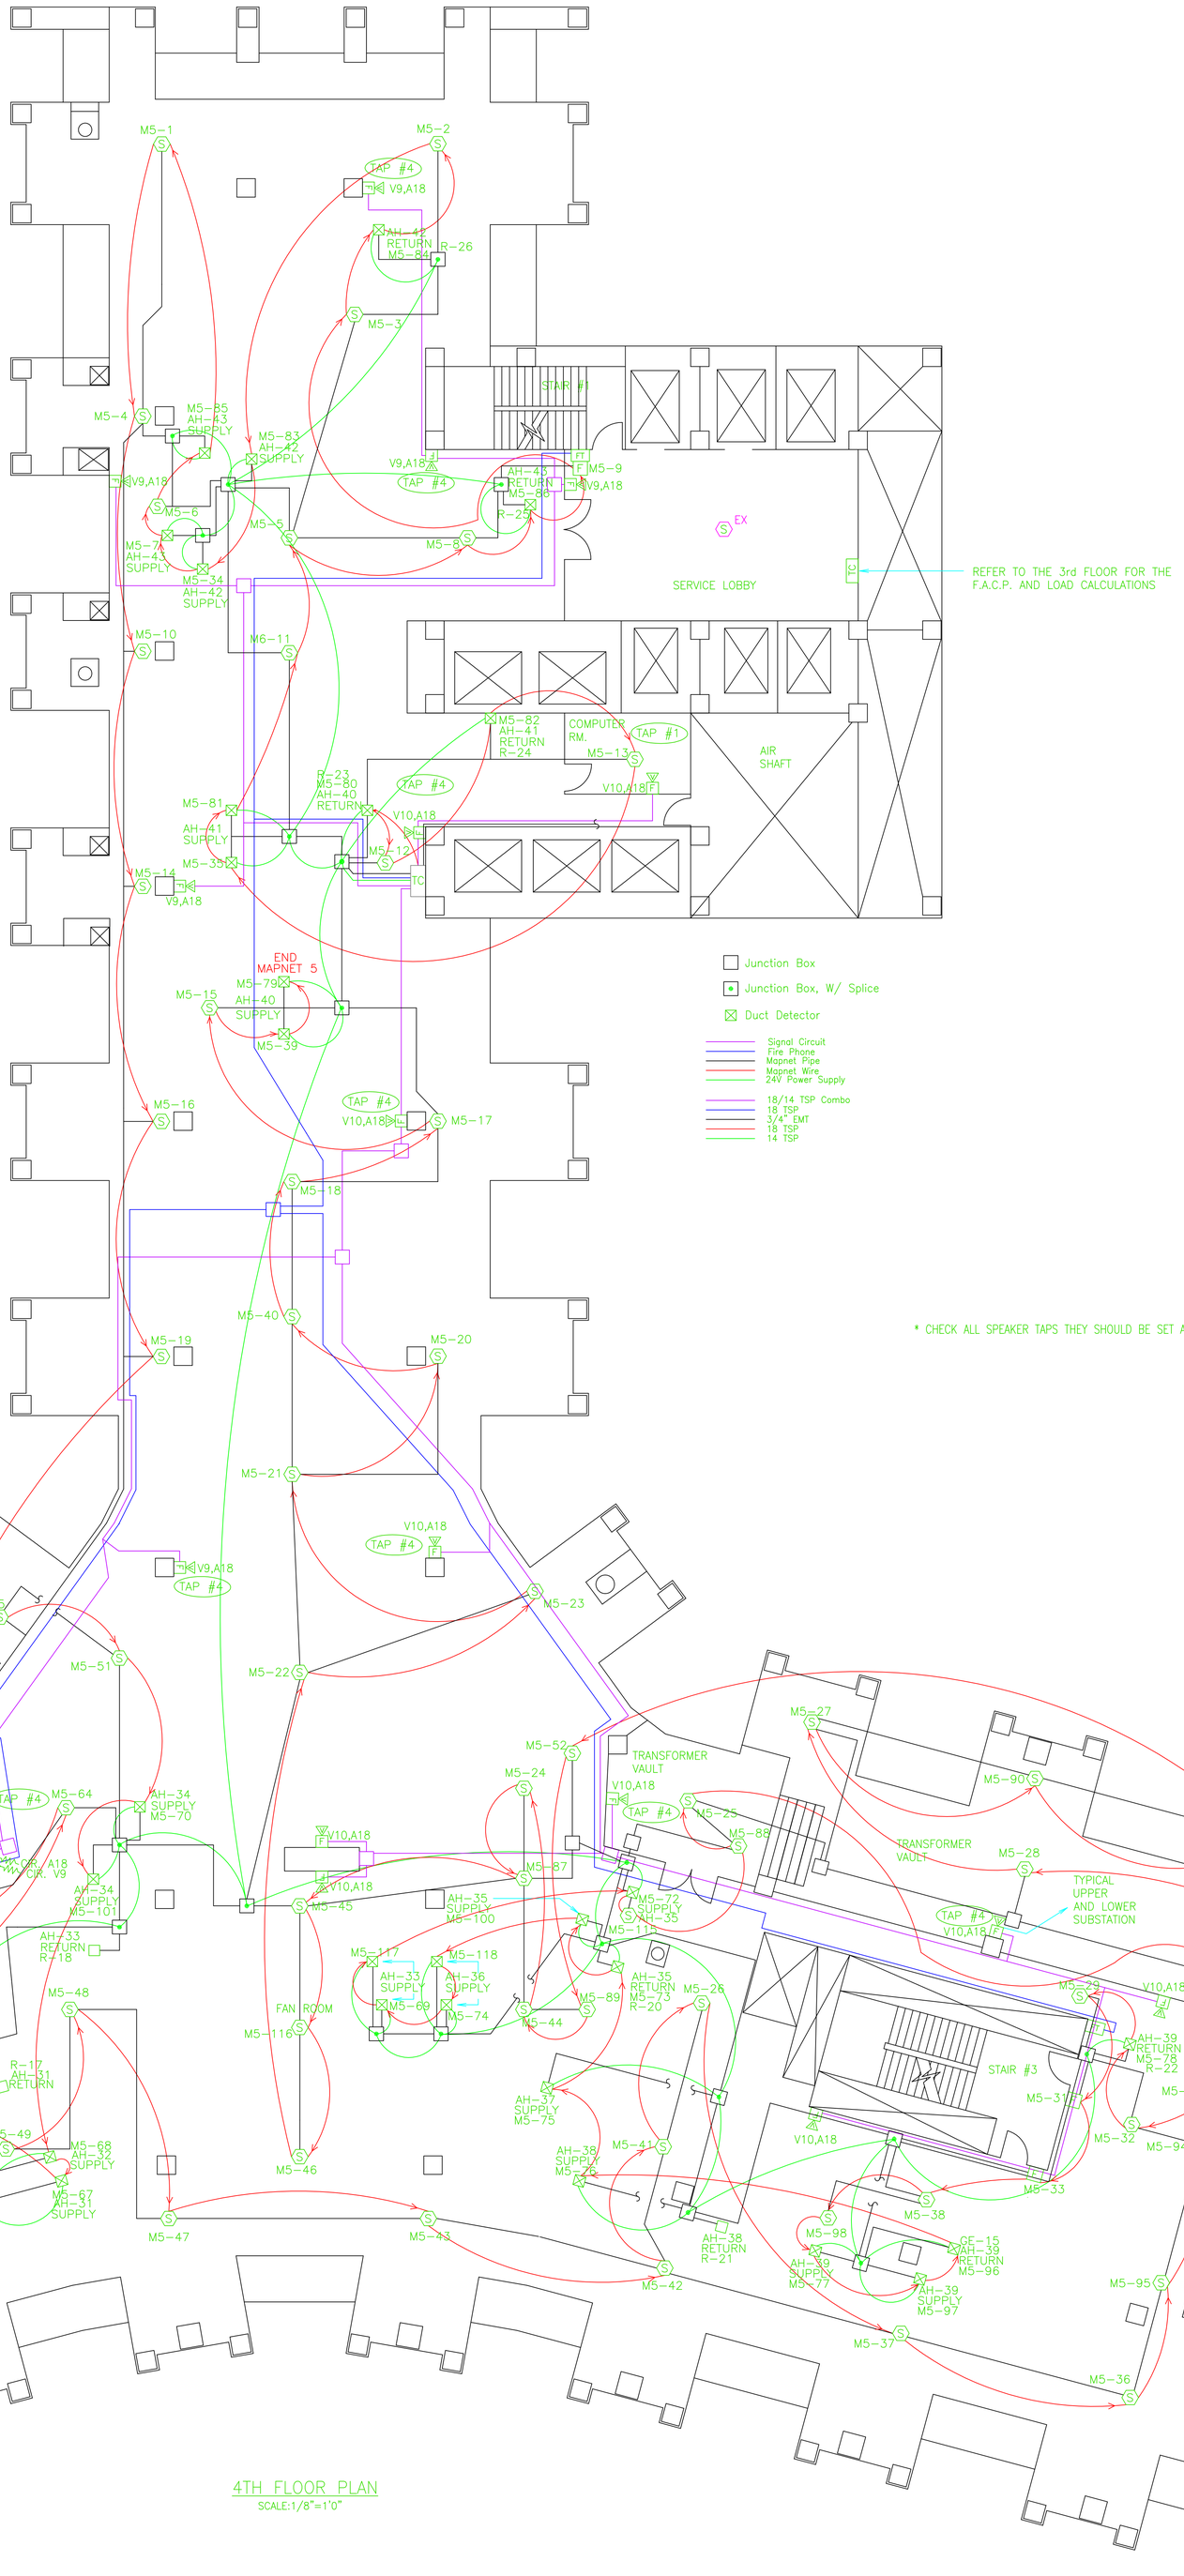

* CHECK ALL SPEAKER TAPS THEY SHOULD BE SET AT 2 WATTS

4TH FLOOR PLAN
SCALE:1/8"=1'0"

tyco / Fire & Security /
SimplexGrinnell
© TYCO INTERNATIONAL LTD.
CONFIDENTIAL INFORMATION
2001 SIMPLEXGRINNELL
GARDNER, MASS. 01441 USA
35 ARKAY DRIVE
HAUPPAUGE, N.Y. 11788
BRANCH #119
SALES: (631) 404-1000
SERVICE: (631) 404-1010
FAX: (631 514-0189
FIRE ALARM
CCTV
SOUND, TIME AND CONTROL SYSTEMS
ELECTRONIC ACCESS
NURSE CALL
SECURITY SYSTEMS
CONTROLS

P.E. STAMP

LIC. BY THE N.Y.S. DEPT. OF STATE
NCFM # (FM#): 973281
NYS (LIC.) UNIQUE ID#: 120002668B3
EXPIRE DATE: 12/08/2004

NO.	REVISION	DATE
1	AS PER FIRE MARSHAL'S COMMENTS	8-29-03

PROJECT TITLE:
NASSAU COUNTY MEDICAL CENTER

ADDRESS:
2201 HEMPSTEAD TURNPIKE
EAST MEADOW, NY 11554

HARVEST PERFORATION
CARMAN AVENUE

DRAWING TITLE:
FOURTH FLOOR PLAN
FIRE ALARM SYSTEM

DRAWN BY: ELEMCO.
CHECKED BY: R.M.
SALES REP.: RON R.
SHEET: - OF -
CONTRACTOR: ELEMCO. ELEC.
SCALE: AS NOTED
DATE: 8-15-00
PROJECT NO:

DRAWING NO:
AUGUST 29, 2002